

Daikin Altherma high
temperature split
Technical Data

ETBH16E6V /
ETBH16E9W /
ETBX16E6V /
ETBX16E9W



ETBH16EF6V
ETBH16EF9W
ETBX16EF6V
ETBX16EF9W

TABLE OF CONTENTS

ETBH16E6V / ETBH16E9W / ETBX16E6V / ETBX16E9W

1	Features	4
	ETBX16E6V, ETBX16E9W, ETBH16E9W, ETBH16E6V	4
2	Specifications	5
3	Electrical data	12
4	Combination table	14
5	Dimensional drawings	15
6	Centre of gravity	16
7	Piping diagrams	17
8	Wiring diagrams	18
	Notes & Legend	18
	Control Circuit	19
	Power Supply, Back-up Heater	21
9	External connection diagrams	22
10	Installation	23
	Installation Method	23
11	Operation range	24
12	Hydraulic performance	25
	Static Pressure Drop Unit	25

1 Features

1 - 1 ETBX16E6V, ETBX16E9W, ETBH16E9W, ETBH16E6V

Wall mounted reversible air to water heat pump

1

- › Inclusion of all hydraulic components means no third party components are required
- › Compact dimensions allows for small installation space, as almost no side clearances are required.
- › The unit's sleek design blends in with other household appliances.
- › Combine with a stainless steel tank or ECH2O thermal store.
- › Quick configuration in 9 steps in a high resolution colour interface wizard



Daikin
Residential
Controller

2 Specifications

1 - 1 ETBX16E6V, ETBX16E9W, ETBH16E9W, ETBH16E6V

Technical specifications				ETBH16E6V		
Heater capacity	Step 1		kW	2		
	Step 2		kW	2 or 4		
Power input	Nom.		kW	0.21		
Casing	Colour			White + Black		
	Material			Resin, sheet metal		
Dimensions	Unit	Height	mm	840		
		Width	mm	440		
		Depth	mm	390		
	Packed unit	Height	mm	450		
		Width	mm	650		
		Depth	mm	1,016		
Weight	Unit		kg	38.0		
	Packed unit		kg	42		
Packing	Material			Carton / PP (Straps) / EPS		
	Weight		kg	4		
Pump	Nr of speeds			PWM		
	Power input		W	179		
Water side Heat exchanger	Water flow rate	Min.	l/min	20.0 (1)		
Expansion vessel	Volume		l	10		
	Max. water pressure		bar	3		
	Pre pressure		bar	1		
Water filter	Diameter perforations		mm	0.8		
	Material			Stainless steel / Plastic		
General	Supplier/Manufacturer details	Name or trademark		Daikin Europe N.V.		
		Name and address		Daikin Europe N.V. - Zandvoordestraat 300, 8400 Oostende, Belgium		
Water circuit	Piping connections diameter		inch	G 1" (female)		
	Piping material			Cu		
	Internal piping diameter		inch	1-1/4"		
	Piping		inch	1"		
	Safety valve		bar	3		
	Manometer			Digital		
	Drain valve / fill valve			No		
	Shut off valve			Yes		
	flowswitch			Yes		
	Air purge valve			Yes		
	Total water volume		l	2.2 (2)		
Water circuit	Minimum water volume in the system for cooling		l	20 (3)		
	Minimum water volume in the system for heating		l	20 (3)		
Sound power level	Nom.		dB(A)	44.0 (4)		
Sound pressure level	Nom.		dB(A)	30.0 (5)		
Operation range	Heating	Ambient	Min.	°C	0 (6)	
			Max.	°C	0 (6)	
		Water side	Min.	°C	0 (6)	
			Max.	°C	0 (6)	
	Indoor installation	Ambient	Min.	°CDB	5	
			Max.	°CDB	35 (7)	
	Cooling	Ambient	Min.	°CDB	0 (6)	
			Max.	°CDB	0 (6)	
		Water side	Min.	°C	0 (6)	
			Max.	°C	0 (6)	
		Domestic hot water	Water side	Min.	°C	0 (6)
				Max.	°C	0 (6)
Safety devices	Item	01		Thermal cut out		

Electrical specifications				ETBH16E6V	
Power supply	Name			See note 9	
	Voltage range	Min.	%	-10	
Max.		%		10	
IP class	IP			IP X0B	
Electric heater	Power supply	Name		6V3	
		Phase		1~ / 3~	
		Frequency	Hz	50	
		Voltage	V	230	
	Current	Maximum running current		A	26.0
		Zmax	List	Ω	0.22
		Minimum Ssc value			Equipment complying with EN/IEC 61000-3-12
Recommended fuses			A	20.000 (8)	

2 Specifications

1 - 1 ETBX16E6V, ETBX16E9W, ETBH16E9W, ETBH16E6V

2

Electrical specifications			ETBH16E6V
Wiring connections	Communication cable	Quantity	3
		Remark	2.5 mm ²
Electric meter		Quantity	2
		Remark	Minimum 0.75 mm ² (5VDC pulse detection)
Preferential kWh rate power supply		Quantity	Power: 2
		Remark	Power 6.3A (Select diameter and type according to national and local regulations)
Domestic hot water pump		Quantity	2
		Remark	Minimum 0.75 mm ² (2A inrush, 1A continuous)
For power supply back-up heater		Quantity	Prewired
For connection with R6T		Quantity	2
		Remark	Minimum 0.75 mm ²
For connection with A3P		Quantity	Depends on thermostat type, cf. installation manual
		Remark	Voltage: 230V / Max. current: 100mA / Min. 0.75mm ²
For connection with M2S		Quantity	2
		Remark	Voltage: 230V / Max. current: 100mA / Min. 0.75mm ²
For connection with optional FWXV* (demand		Quantity	4
		Remark	100 mA, minimum 0.75 mm ²

(1) Operation area is extended to lower flow rates only in case the unit operates with heat pump only. (Not in startup, no BUH operation, no defrost operation). |

(2) Including piping + back-up heater; excluding expansion vessel |

(3) Excluding the water in the unit. This minimum water volume is sufficient for most applications. During critical processes extra water may be required. |

(4) Measured with a pressure drop of 10 kPa in the heating system at an operating condition of leaving water 47-55°C in a room with an ambient of 20°C. DB/WB 7°C/6°. |

(5) Value measured in an anechoic room at 1m distance from the unit. It is a relative value, depending on the distance and acoustic environment. The sound pressure level mentioned is measured with a pressure drop of 10 kPa in the heating system at an operatin |

(6) Refer to operation range of the unit. |

(7) Depends on operation mode, refer to installation manual. |

(8) 4 pole 20 A curve 400V tripping class C (refer to wiring diagram) |

(9) Above mentioned power supply of the hydrobox is for the backup heater only. The switch box and the pump of the hydrobox are supplied via the outdoor unit. The optional domestic hot water tank has a separate power supply.

Technical specifications			ETBH16E9W	
Heater capacity	Step 1	kW	3	
	Step 2	kW	max. 6 kW	
Power input	Nom.	kW	0.21	
Casing	Colour		White + Black	
	Material		Resin, sheet metal	
Dimensions	Unit	Height	mm	840
		Width	mm	440
		Depth	mm	390
	Packed unit	Height	mm	450
		Width	mm	650
		Depth	mm	1,016
Weight	Unit	kg	38.0	
	Packed unit	kg	42	
Packing	Material		Carton / PP (Straps) / EPS	
	Weight	kg	4	
Pump	Nr of speeds		PWM	
	Power input	W	179	
Water side Heat exchanger	Water flow rate	Min.	l/min	20.0 (1)
Expansion vessel	Volume	l	10	
	Max. water pressure	bar	3	
	Pre pressure	bar	1	
Water filter	Diameter perforations	mm	0.8	
	Material		Stainless steel / Plastic	
General	Supplier/Manufacturer details	Name or trademark	Daikin Europe N.V.	
		Name and address	Daikin Europe N.V. - Zandvoordestraat 300, 8400 Oostende, Belgium	
Water circuit	Piping connections diameter		inch	G 1" (female)
	Piping material			Cu
	Internal piping diameter		inch	1-1/4"
	Piping		inch	1"
	Safety valve		bar	3
	Manometer			Digital
	Drain valve / fill valve			No
	Shut off valve			Yes
	flowswitch			Yes
	Air purge valve			Yes
	Total water volume		l	2.2 (2)

2 Specifications

1 - 1 ETBX16E6V, ETBX16E9W, ETBH16E9W, ETBH16E6V

Technical specifications				ETBH16E9W	
Water circuit	Minimum water volume in the system I for cooling				20 (3)
	Minimum water volume in the system I for heating				20 (3)
Sound power level	Nom.		dB(A)		44.0 (4)
Sound pressure level	Nom.		dB(A)		30.0 (5)
Operation range	Heating	Ambient	Min.	°C	0 (6)
			Max.	°C	0 (6)
		Water side	Min.	°C	0 (6)
			Max.	°C	0 (6)
	Indoor installation	Ambient	Min.	°CDB	5
			Max.	°CDB	35 (7)
	Cooling	Ambient	Min.	°CDB	0 (6)
			Max.	°CDB	0 (6)
		Water side	Min.	°C	0 (6)
			Max.	°C	0 (6)
Domestic hot water		Water side	Min.	°C	0 (6)
			Max.	°C	0 (6)
Safety devices	Item	01			Thermal cut out

Electrical specifications				ETBH16E9W		
Power supply	Name		See note 9			
	Voltage range	Min.	%	-10		
		Max.	%	10		
IP class	IP		IP X0B			
Electric heater	Power supply	Name		9W		
		Phase		3~		
		Frequency		50 Hz		
		Voltage		400 V		
		Current		Maximum running current A		13.0
Wiring connections	Recommended fuses		A			20.000 (8)
	Communication cable	Quantity				3
		Remark				2.5 mm ²
	Electric meter	Quantity				2
		Remark				Minimum 0.75 mm ² (5VDC pulse detection)
	Preferential kWh rate power supply	Quantity				Power: 2
		Remark				Power 6.3A (Select diameter and type according to national and local regulations)
	Domestic hot water pump	Quantity				2
		Remark				Minimum 0.75 mm ² (2A inrush, 1A continuous)
	For power supply back-up heater	Quantity				Prewired
	For connection with R6T	Quantity				2
		Remark				Minimum 0.75 mm ²
	For connection with A3P	Quantity				Depends on thermostat type, cf. installation manual
Remark					Voltage: 230V / Max. current: 100mA / Min. 0.75mm ²	
For connection with M2S	Quantity				2	
	Remark				Voltage: 230V / Max. current: 100mA / Min. 0.75mm ²	
For connection with optional FWXV* (demand	Quantity				4	
	Remark				100 mA, minimum 0.75 mm ²	

(1) Operation area is extended to lower flow rates only in case the unit operates with heat pump only. (Not in startup, no BUH operation, no defrost operation). |

(2) Including piping + back-up heater; excluding expansion vessel |

(3) Excluding the water in the unit. This minimum water volume is sufficient for most applications. During critical processes extra water may be required. |

(4) Measured with a pressure drop of 10 kPa in the heating system at an operating condition of leaving water 47-55°C in a room with an ambient of 20°C. DB/WB 7°C/6°. |

(5) Value measured in an anechoic room at 1m distance from the unit. It is a relative value, depending on the distance and acoustic environment. The sound pressure level mentioned is measured with a pressure drop of 10 kPa in the heating system at an operatin |

(6) Refer to operation range of the unit. |

(7) Depends on operation mode, refer to installation manual. |

(8) 4 pole 20 A curve 400V tripping class C (refer to wiring diagram) |

(9) Above mentioned power supply of the hydrobox is for the backup heater only. The switch box and the pump of the hydrobox are supplied via the outdoor unit. The optional domestic hot water tank has a separate power supply.

Technical specifications				ETBX16E6V	
Heater capacity	Step 1	kW		2	
	Step 2	kW		2 or 4	
Power input	Nom.	kW		0.21	

2 Specifications

1 - 1 ETBX16E6V, ETBX16E9W, ETBH16E9W, ETBH16E6V

2

Technical specifications				ETBX16E6V		
Casing	Colour			White + Black		
	Material			Resin, sheet metal		
Dimensions	Unit	Height	mm	840		
		Width	mm	440		
		Depth	mm	390		
	Packed unit	Height	mm	450		
		Width	mm	650		
		Depth	mm	1,016		
Weight	Unit		kg	38.0		
	Packed unit		kg	42		
Packing	Material			Carton / PP (Straps) / EPS		
	Weight			kg	4	
Pump	Nr of speeds			PWM		
	Power input			W	179	
Water side Heat exchanger	Water	Min.	l/min	20.0 (1)		
Expansion vessel	Volume			l	10	
	Max. water pressure			bar	3	
	Pre pressure			bar	1	
Water filter	Diameter perforations			mm	0.8	
	Material			Stainless steel / Plastic		
General	Supplier/	Name or trademark		Daikin Europe N.V.		
	Manu- facturer	Name and address		Daikin Europe N.V. - Zandvoordestraat 300, 8400 Oostende, Belgium		
Water circuit	Piping connections diameter			inch	G 1" (female)	
	Piping material			Cu		
	Internal piping diameter			inch	1-1/4"	
	Piping			inch	1"	
	Safety valve			bar	3	
	Manometer			Digital		
	Drain valve / fill valve			No		
	Shut off valve			Yes		
	flowswitch			Yes		
	Air purge valve			Yes		
	Total water volume			l	2.2 (2)	
	Water circuit	Minimum water volume in the system for cooling			l	20 (3)
Minimum water volume in the system for heating			l	20 (3)		
Sound power level	Nom.			dB(A)	44.0 (4)	
Sound pressure level	Nom.			dB(A)	30.0 (5)	
Operation range	Heating	Ambient	Min.	°C	0 (6)	
			Max.	°C	0 (6)	
		Water side	Min.	°C	0 (6)	
			Max.	°C	0 (6)	
	Indoor installation	Ambient	Min.	°CDB	5	
			Max.	°CDB	35 (7)	
		Cooling	Ambient	Min.	°CDB	0 (6)
				Max.	°CDB	0 (6)
	Domestic hot water	Water side	Min.	°C	0 (6)	
			Max.	°C	0 (6)	
		Water side	Min.	°C	0 (6)	
			Max.	°C	0 (6)	
Safety devices	Item	01		Thermal cut out		

Electrical specifications				ETBX16E6V		
Power supply	Name			See note 9		
	Voltage range	Min.	%	-10		
		Max.	%	10		
IP class	IP			IP X0B		
Electric heater	Power supply	Name		6V3		
		Phase		1~ / 3~		
		Frequency		Hz	50	
		Voltage		V	230	
	Current	Maximum running current			A	26.0
		Zmax	List	Ω	0.22	
		Minimum Ssc value			Equipment complying with EN/IEC 61000-3-12	
		Recommended fuses			A	20.000 (8)

2 Specifications

1 - 1 ETBX16E6V, ETBX16E9W, ETBH16E9W, ETBH16E6V

Electrical specifications			ETBX16E6V
Wiring connections	Communication cable	Quantity	3
		Remark	2.5 mm ²
Electric meter		Quantity	2
		Remark	Minimum 0.75 mm ² (5VDC pulse detection)
Preferential kWh rate power supply		Quantity	Power: 2
		Remark	Power 6.3A (Select diameter and type according to national and local regulations)
Domestic hot water pump		Quantity	2
		Remark	Minimum 0.75 mm ² (2A inrush, 1A continuous)
For power supply back-up heater		Quantity	Prewired
For connection with R6T		Quantity	2
		Remark	Minimum 0.75 mm ²
For connection with A3P		Quantity	Depends on thermostat type, cf. installation manual
		Remark	Voltage: 230V / Max. current: 100mA / Min. 0.75mm ²
For connection with M2S		Quantity	2
		Remark	Voltage: 230V / Max. current: 100mA / Min. 0.75mm ²
For connection with optional FWXV* (demand		Quantity	4
		Remark	100 mA, minimum 0.75 mm ²

(1) Operation area is extended to lower flow rates only in case the unit operates with heat pump only. (Not in startup, no BUH operation, no defrost operation). |

(2) Including piping + back-up heater; excluding expansion vessel |

(3) Excluding the water in the unit. This minimum water volume is sufficient for most applications. During critical processes extra water may be required. |

(4) Measured with a pressure drop of 10 kPa in the heating system at an operating condition of leaving water 47-55°C in a room with an ambient of 20°C. DB/WB 7°C/6°. |

(5) Value measured in an anechoic room at 1m distance from the unit. It is a relative value, depending on the distance and acoustic environment. The sound pressure level mentioned is measured with a pressure drop of 10 kPa in the heating system at an operatin |

(6) Refer to operation range of the unit. |

(7) Depends on operation mode, refer to installation manual. |

(8) 4 pole 20 A curve 400V tripping class C (refer to wiring diagram) |

(9) Above mentioned power supply of the hydrobox is for the backup heater only. The switch box and the pump of the hydrobox are supplied via the outdoor unit. The optional domestic hot water tank has a separate power supply.

Technical specifications			ETBX16E9W	
Heater capacity	Step 1	kW	3	
	Step 2	kW	max. 6 kW	
Power input	Nom.	kW	0.21	
Casing	Colour		White + Black	
	Material		Resin, sheet metal	
Dimensions	Unit	Height	mm	840
		Width	mm	440
		Depth	mm	390
	Packed unit	Height	mm	450
		Width	mm	650
		Depth	mm	1,016
Weight	Unit	kg	38.0	
	Packed unit	kg	42	
Packing	Material		Carton / PP (Straps) / EPS	
	Weight	kg	4	
Pump	Nr of speeds		PWM	
	Power input	W	179	
Water side Heat exchanger	Water Min. flow rate	l/min	20.0 (1)	
Expansion vessel	Volume	l	10	
	Max. water pressure	bar	3	
	Pre pressure	bar	1	
Water filter	Diameter perforations	mm	0.8	
	Material		Stainless steel / Plastic	
General	Supplier/Manufacturer details	Name or trademark	Daikin Europe N.V.	
		Name and address	Daikin Europe N.V. - Zandvoordestraat 300, 8400 Oostende, Belgium	
Water circuit	Piping connections diameter		inch	G 1" (female)
	Piping material			Cu
	Internal piping diameter		inch	1-1/4"
	Piping		inch	1"
	Safety valve		bar	3
	Manometer			Digital
	Drain valve / fill valve			No
	Shut off valve			Yes
	flowswitch			Yes
	Air purge valve			Yes
	Total water volume		l	2.2 (2)

2 Specifications

1 - 1 ETBX16E6V, ETBX16E9W, ETBH16E9W, ETBH16E6V

2

Technical specifications				ETBX16E9W	
Water circuit		Minimum water volume in the system I for cooling			20 (3)
		Minimum water volume in the system I for heating			20 (3)
Sound power level	Nom.		dB(A)		44.0 (4)
Sound pressure level	Nom.		dB(A)		30.0 (5)
Operation range	Heating	Ambient	Min.	°C	0 (6)
			Max.	°C	0 (6)
		Water side	Min.	°C	0 (6)
			Max.	°C	0 (6)
	Indoor installation	Ambient	Min.	°CDB	5
			Max.	°CDB	35 (7)
	Cooling	Ambient	Min.	°CDB	0 (6)
			Max.	°CDB	0 (6)
		Water side	Min.	°C	0 (6)
			Max.	°C	0 (6)
Domestic hot water		Water side	Min.	°C	0 (6)
			Max.	°C	0 (6)
Safety devices	Item	01			Thermal cut out

Electrical specifications				ETBX16E9W			
Power supply	Name			See note 9			
		Voltage range	Min.	%	-10		
			Max.	%	10		
IP class	IP			IP X0B			
Electric heater supply	Power supply	Name			9W		
		Phase			3~		
		Frequency	Hz			50	
		Voltage	V			400	
		Current	Maximum running current	A			13.0
		Recommended fuses			A	20.000 (8)	
Wiring connections	Communication cable	Quantity			3		
		Remark			2.5 mm ²		
	Electric meter	Quantity			2		
		Remark			Minimum 0.75 mm ² (5VDC pulse detection)		
	Preferential kWh rate power supply	Quantity			Power: 2		
		Remark			Power 6.3A (Select diameter and type according to national and local regulations)		
	Domestic hot water pump	Quantity			2		
		Remark			Minimum 0.75 mm ² (2A inrush, 1A continuous)		
	For power supply back-up heater	Quantity			Prewired		
	For connection with R6T	Quantity			2		
		Remark			Minimum 0.75 mm ²		
	For connection with A3P	Quantity			Depends on thermostat type, cf. installation manual		
Remark				Voltage: 230V / Max. current: 100mA / Min. 0.75mm ²			
For connection with M2S	Quantity			2			
	Remark			Voltage: 230V / Max. current: 100mA / Min. 0.75mm ²			
For connection with optional FWXV* (demand	Quantity			4			
	Remark			100 mA, minimum 0.75 mm ²			

(1) Operation area is extended to lower flow rates only in case the unit operates with heat pump only. (Not in startup, no BUH operation, no defrost operation). |

(2) Including piping + back-up heater; excluding expansion vessel |

(3) Excluding the water in the unit. This minimum water volume is sufficient for most applications. During critical processes extra water may be required. |

(4) Measured with a pressure drop of 10 kPa in the heating system at an operating condition of leaving water 47-55°C in a room with an ambient of 20°C. DB/WB 7°C/6°. |

(5) Value measured in an anechoic room at 1m distance from the unit. It is a relative value, depending on the distance and acoustic environment. The sound pressure level mentioned is measured with a pressure drop of 10 kPa in the heating system at an operatin |

(6) Refer to operation range of the unit. |

(7) Depends on operation mode, refer to installation manual. |

(8) 4 pole 20 A curve 400V tripping class C (refer to wiring diagram) |

(9) Above mentioned power supply of the hydrobox is for the backup heater only. The switch box and the pump of the hydrobox are supplied via the outdoor unit. The optional domestic hot water tank has a separate power supply.

2 Specifications

1 - 1 ETBX16E6V, ETBX16E9W, ETBH16E9W, ETBH16E6V

3 Electrical data

3 - 1 Electrical Data

3

Electrical specifications of the backup heaters and booster heaters												
Backup heater	Type		6V				9W					
			2 - 4		2 - 6		2-4 (in case of emergency: 2-6)		6		3 - 6 (in case of emergency: 3 - 9)	
	Capacity setting		[kW]		2	4	2	6	1	6	2	9
	Capacity stage		[kW]		2	2	2	2	1	3	2	3
	Capacity stage 1		[kW]		2	2	2	2	6	3	3	3
Capacity stage 2		[kW]		4	6	4	6	-	6	9	6	
Minimum time delay between stages												
Note 4												
Power supply		Phase		1~				3~				
(1)		Frequency		50				50				
		Voltage		230 +10%				400 +10%				
		Nominal running current		17,4	26,1	17,4	26,1	15	8,7	13	8,7	13
Current		Zmax (backup heat(2))		0,22				-				
		Minimum Ssc value		[3]				-				
Notes												
(1) The above-mentioned power supply of the hydrobox is for the backup heater only. The optional domestic hot water tank has a separate power supply.												
(2) In accordance with EN/IEC 61000-3-11, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with Zsys ≤ Zmax.												
(3) The equipment complies with EN/IEC 61000-3-12.												
EN/IEC 61000-3-11 European/International Technical Standard setting the limits for voltage changes, voltage fluctuations and flicker in public low-voltage supply systems for equipment with rated current ≤ 75 A.												
EN/IEC 61000-3-12 European/International Technical Standard setting the limits for harmonic currents produced by equipment connected to public low-voltage systems with input current > 16 A and ≤ 75 A per phase.												
Zsys System impedance												

Electrical specifications of the backup heaters and booster heaters												
Booster heater (optional) ("KH W" models)	Type		6V				9W					
			2 - 4		2 - 6		2-4 (in case of emergency: 2-6)		6		3 - 6 (in case of emergency: 3 - 9)	
	Capacity setting		[kW]		2	4	2	6	1	6	2	9
	Capacity stage		[kW]		2	2	2	2	1	3	2	3
	Capacity stage 1		[kW]		2	2	2	2	6	3	3	3
Capacity stage 2		[kW]		4	6	4	6	-	6	9	6	
Minimum time delay between stages												
Note 5												
Power supply		Phase		1~				3~				
(1)		Frequency		50				50				
		Voltage		230 +10%				400 +10%				
		Nominal running current		17,4	26,1	17,4	26,1	15	8,7	13	8,7	13
Current		Zmax (backup heat(2))		0,22				-				
		Minimum Ssc value		[3]				-				
Notes												
(1) The above-mentioned power supply of the hydrobox is for the backup heater only. The optional domestic hot water tank has a separate power supply.												
(2) In accordance with EN/IEC 61000-3-11, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with Zsys ≤ Zmax.												
(3) The equipment complies with EN/IEC 61000-3-12.												
EN/IEC 61000-3-11 European/International Technical Standard setting the limits for voltage changes, voltage fluctuations and flicker in public low-voltage supply systems for equipment with rated current ≤ 75 A.												
EN/IEC 61000-3-12 European/International Technical Standard setting the limits for harmonic currents produced by equipment connected to public low-voltage systems with input current > 16 A and ≤ 75 A per phase.												
Zsys System impedance												

The top graph illustrates the capacity (kW) over time for a backup heater (6V/9W). It shows two stages: Stage 1 and Stage 2. Stage 1 has a capacity of 2 kW and Stage 2 has a capacity of 4 kW. The minimum time delay between stages is 2 minutes. The graph also shows a 10-second delay at the start and a 10-minute delay at the end. A note indicates that in case of domestic hot water operation, the delay is 3 minutes.

The bottom graph illustrates the capacity (kW) over time for a booster heater. It shows a single stage with a capacity of 2 kW. The minimum time delay between stages is 50 minutes. A note indicates that unless manually activated, the delay is 1 minute.

4D121020B

3 Electrical data

3 - 1 Electrical Data

ETBH16E6V / ETBH16E9W / ETBX16E6V / ETBX16E9W
 ETVH16E6V / ETVH16UE6V / ETVH16E9W
 ETVX16E6V / ETVX16E9W
 ETVZ16E6V / ETVZ16E9W

* Electrical meter specification

Pulse meter type/voltage-free contact for 5 V DC detection by PCB.

- Possible number of pulses

- 0.1· pulse/kWh
- 1· pulse/kWh
- 10· pulse/kWh
- 100· pulse/kWh
- 1000· pulse/kWh

- Pulse duration

minimum On time: ·40ms·
 Minimum OFF time: ·100ms·

- Measurement type (depending on installation)

- Single-phase AC meter
- Three-phase AC meter
 - Balanced loads
 - Unbalanced loads

* Electrical meter installation guideline

- It is the responsibility of the installer to cover the complete power consumption with electrical meters (combination of estimation and metering is not allowed).

- Required number of electrical meters

Outdoor unit type		EPRA(14/16/18)(D/E)A*					
Indoor unit type		ETB(H/X)16(D/E)A*			ETV(H/X/Z)16S*(D/E)A*		
Backup heater type		6V		9W	6V		9W
Backup heater power supply		1~ 230V	3~ 230V	3~ 400V	1~ 230V	3~ 230V	3~ 400V
Backup heater configuration		2 / 4 / 6 kW	6 kW	3 / 6 / 9 kW	2 / 4 / 6 kW	6 kW	3 / 6 / 9 kW
Normal kWh rate power supply							
Electrical meter type	1~	1	-	-	1	-	-
	3~ balanced	-	-	-	-	-	-
	3~ unbalanced	-	1	1	-	1	1
Preferential kWh rate power supply							
Electrical meter type	1~	2	1	1	2	1	1
	3~ balanced	-	-	-	-	-	-
	3~ unbalanced	-	1	1	-	1	1

4D126533A

4 Combination table

4 - 1 Combination Table

4

ETBH16E6V
ETBH16E9W
ETBX16E6V
ETBX16E9W

Factory-mounted equipment for -ETB(H/X)16EF*-

Description	ETB(H/X)16EF*	
Heating only model -ETBH-	6V (8)	9W (8)
Reversible model -ETBX-	6V (8)	9W (8)
Backup heater ·2-4-6kW 1N-230 V·	o	-
Backup heater ·2-4-6kW 3-230 V·	o	-
Backup heater ·3-6-9kW 3N-400 V·	-	o

Outdoor combination table for -ETB(H/X)16EF*-

Description		EPRA14DA(V3/W1)	EPRA16DA(V3/W1)	EPRA18DA(V3/W1)
ETBH16EF*	Heating only	o	o	o
ETBX16EF*	Reversible	o	o	o

Kit availability for indoor units

Reference	Description	ETB*16EF*	
ETBH*	Heating only indoor unit	6V	9W
ETBX*	Reversible indoor unit	6V	9W
EKRP1HBAA	Digital I/O PCB	* (1) (2)	o
EKRP1AHTA	Demand PCB	* (3)	o
BRC1HHDA*	HCI (Human Comfort Interface)		o
EKPCAB4	PC cable	* (4)	o
EKHS150D3V3	Domestic hot water tank ·150 l 1-230 V·	o	o
EKHS180D3V3	Domestic hot water tank ·180 l 1-230 V·	o	o
EKHS200D3V3	Domestic hot water tank ·200 l 1-230 V·	o	o
EKHS250D3V3	Domestic hot water tank ·250 l 1-230 V·	o	o
EKHS300D3V3	Domestic hot water tank ·300 l 1-230 V·	o	o
EKHSU150D3V3	Domestic hot water tank ·150 l 1-230 V·	o	o
EKHSU180D3V3	Domestic hot water tank ·180 l 1-230 V·	o	o
EKHSU200D3V3	Domestic hot water tank ·200 l 1-230 V·	o	o
EKHSU250D3V3	Domestic hot water tank ·250 l 1-230 V·	o	o
EKHSU300D3V3	Domestic hot water tank ·300 l 1-230 V·	o	o
EKHWP500B	Domestic hot water tank with solar connection	* (9) (10)	o
EKHWP500PB	Domestic hot water tank with solar connection	* (9) (10)	o
EKHWP300B	Domestic hot water tank with solar connection	* (9) (10)	o
EKHWP300PB	Domestic hot water tank with solar connection	* (9) (10)	o
EKHY3PART	Third-party tank connection kit for thermistor pocket		o
EKMIKPOA	Mixing kit - PCB only	o	o
EKMIKPHA	Mixing kit - PCB with hydraulics	o	o
EKMIKHMA	Hydraulics - mixed pump group	* (13)	o
EKMIKHUA	Hydraulics - unmixed pump group	* (13)	o
EKMIKBVA	Balancing vessel		o
EKMIKDIA	Distributor for balancing vessel	* (14)	o
KRCS01-1	Remote indoor sensor	* (5)	o
EKRSCA1	Remote sensor for outdoor	* (5)	o
EKCC8-W	Universal centralised user interface		o
DCOM-LT/10	DCOM gateway		o
DCOM-LT/MB	DCOM gateway		o
BRP069A71	WLAN module	* (12)	o
ESAE04A01*	Daikin Residential Controller		o
EKRELSG	Relay for Smart Grid		o
EKHBCONV	Conversion kit: heating only to reversible.		o
AFVALVE1	Freeze protection valve		o
FWXV10-15-20ATV3*	Heat pump convector	* (6)	o
FWXT10-15-20ATV3*	Heat pump convector	* (6)	o
FWXM10-15-20ATV3*	Heat pump convector	* (6)	o
EKVKHPK	Heat pump convector valve kit	* (6)	o
EKRTWA	Wired room thermostat		o
EKRTR1	Wireless room thermostat		o
EKRTETS	External sensor room thermostat	* (7)	o
EKWUFHTA1V3	Multi-zoning base unit 230 V	* (11)	o
EKWCTRD1V3	Digital thermostat 230 V	* (11)	o
EKWCTRAN1V3	Analogue thermostat 230 V	* (11)	o
EKWVATR1V3	Actuator 230 V	* (11)	o

Kit availability for outdoor units

Reference	Description	EPRA14DA(V3/W1)	EPRA16DA(V3/W1)	EPRA18DA(V3/W1)
EKMST1	Mounting stand	o	o	o
EKMST2	Mounting stand	o	o	o

Kit availability for domestic hot water tanks

Reference	Description	EKHWP*		
		500B	500PB	300B
EKSRPS4A	Solar pump station	o	o	o
EKEPRHLT3HX	Dedicated connection kit available.	o	o	o
EKEPRHLT5H	Heating only indoor unit	o	o	o
EKEPRHLT5X	Only for reversible models	o	o	o

Notes

- (1) PCB that provides additional output connections:
 - (a) Control external heat source (bivalent operation).
 - (b) Output remote ON/OFF signal space heating/cooling
 - (c) Remote alarm output
- (2) Additional relays to allow bivalent control in combination with an external room thermostat are field-supplied.
- (3) PCB to receive up to ·4· digital inputs for power limitation
- (4) Data cable for connection with PC.
- (5) Only 1 remote sensor can be connected: indoor OR outdoor sensor.
- (6) The valve kit is mandatory if a heat pump convector is installed on a reversible model (not mandatory for heating only models).
- (7) -EKRTETS- can only be used in combination with -EKRTR1-
- (8) The backup heater capacity depends on a user interface setting.
- (9) Solar pump station
- (10) Dedicated connection kit available: -EKHP*·.
- (11) Multi-zoning wired controls
- (12) The WLAN cartridge is supplied in the accessory bag of the unit and is meant to be plugged
- (13) Only possible in combination with -EKMIKPOA-
- (14) Only possible in combination with -EKMIKBVA· and -EKMIKPHA· or -EKMIKHUA·.

Remark

Other combinations than mentioned in this combination table are prohibited.


3D133684

5 Dimensional drawings

5 - 1 Dimensional Drawings

ETBH16E6V / ETBH16E9W / ETBX16E6V / ETBX16E9W

- ① Holes (Ø8.5) for wall fixation
- ② Water out connection (1" F BSP)
- ③ Water in connection (1" F BSP)
- ④ Flow switch
- ⑤ Backup heater
- ⑥ Pump
- ⑦ User interface
- ⑧ Safety valve Pressure
- ⑨ Air purge
- ⑩ Expansion vessel
- ⑪ Magnetic filter / dirt separator
- ⑫ Space heating water pressure sensor
- ⑬ Shut-off valves
- ⑭ Wire entrance of the power supply / communication wire
- ⑮ Service door
- ⑯ Switch box terminals
- ⑰ Switch box terminals for the domestic hot water tank (option)
- ⑱ Options

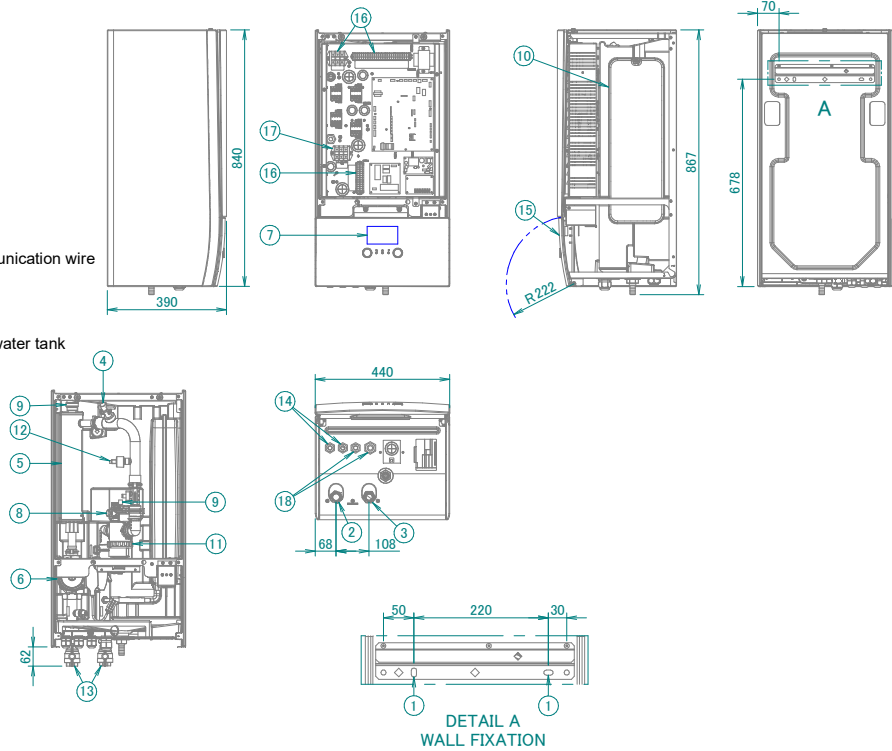



3D121022B

6 Centre of gravity

6 - 1 Centre of Gravity

6

- ETBH12E6V
- ETBH12E9W
- ETBX12E6V
- ETBX12E9W
- ETBH16E6V
- ETBH16E9W
- ETBX16E6V
- ETBX16E9

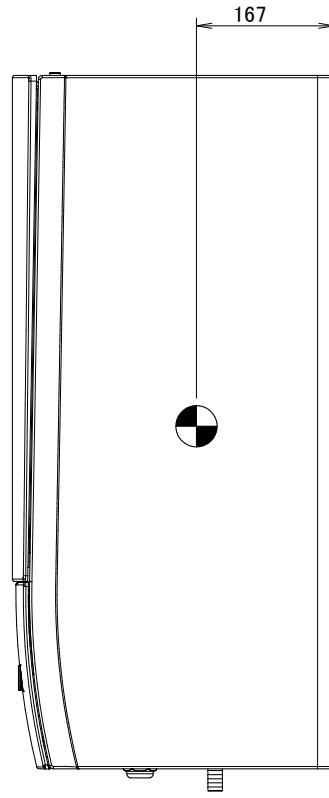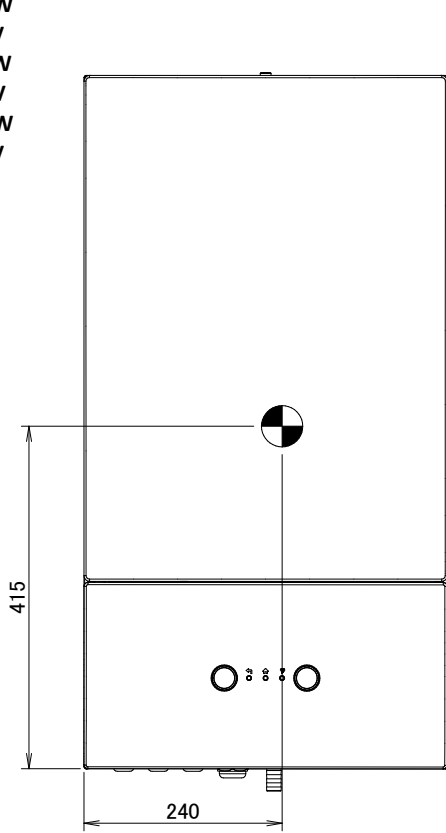


4D121026B

7 Piping diagrams

7 - 1 Piping Diagrams

ETBH12E6V / ETBH16E6V
 ETBH12E9W / ETBH16E9W
 ETBX12E6V / ETBX16E6V
 ETBX12E9W / ETBX16E9W

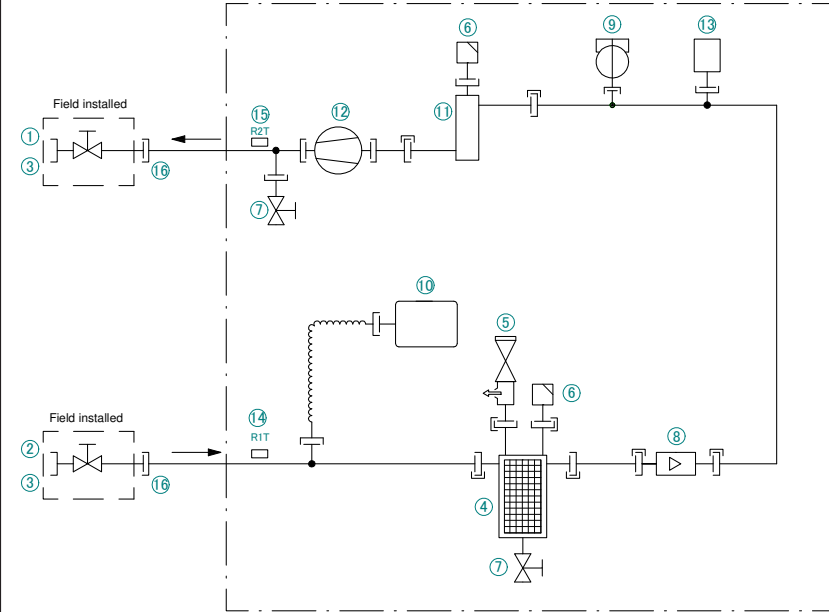

- ① Space heating - water OUT
- Field piping connections
- ② Water in connection ·1"·
- ③ Shut-off valve ·1"· (male-female)
- ④ Magnetic filter / dirt separator
- ⑤ Safety valve
- ⑥ Air purge
- ⑦ Drain valve
- ⑧ Flow sensor
- ⑨ Flow switch
- ⑩ Expansion vessel
- ⑪ Backup heater
- ⑫ Pump
- ⑬ Space heating water pressure sensor
- ⑭ R1T - Inlet water thermistor
- ⑮ R2T - Outlet water backup heater thermistor
- ⑯ Screw connection ·1"·

Screw connection	Brazed connection
Quick coupling	Flare connection

3D120613B

8 Wiring diagrams

8 - 1 Notes & Legend


8

ETBH16E6V
ETBH16E9W
ETBX16E6V
ETBX16E9W

NOTES to go through before starting the unit

- X1M : Main terminal
- X2M : Field wiring terminal for AC
- X5M : Field wiring terminal for DC
- : Earth wiring
- - - : Field supply

① : Several wiring possibilities



: Option



: Wiring depending on model




: Not mounted in switch box



: PCB

- Backup heater power supply
- 6T1 (3~, 230V, 6kW)
 - 6V3 (1N~, 230V, 6kW)
 - 6WN/9WN (3N~, 400V, 6/9kW)
- User installed options:
- Remote user interface
 - Ext. indoor thermistor
 - Ext. outdoor thermistor
 - Digital I/O PCB
 - Demand PCB
 - Safety thermostat
 - Smartgrid
 - WLAN adapter module
 - WLAN cartridge
 - Bizone mixing kit
 - Domestic hot water tank
- Main LWT:
- ON/OFF thermostat (wired)
 - ON/OFF thermostat (wireless)
 - Ext. thermistor
 - Heat pump convector
- Add LWT:
- ON/OFF thermostat (wired)
 - ON/OFF thermostat (wireless)
 - Ext. thermistor
 - Heat pump convector

POSITION IN SWITCH BOX

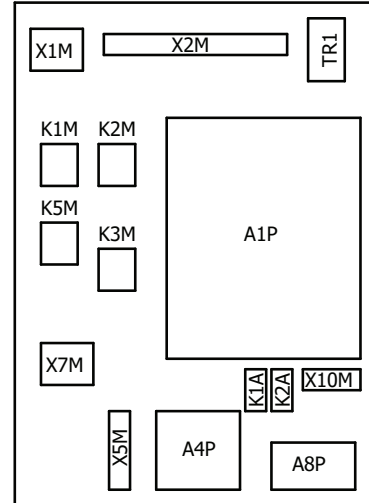

NOTES

1. Connection point of the power supply for the BUH/BSH should be foreseen outside the unit.

LEGEND

Part n°	Description	Part n°	Description
A1P	main PCB	P1M	MMI display
A2P	* ON/OFF thermostat (PC = power circuit)	PC (A15P)	* power circuit
A3P	* heat pump convector	PHC1 (A4P)	* optocoupler input circuit
A4P	* digital I/O PCB	Q1L	thermal protector backup heater
A8P	* demand PCB	Q2L	* thermal protector booster heater
A9P	status indicator	Q4L	# safety thermostat
A11P	MMI main PCB	Q*DI	# earth leakage circuit breaker
A14P	* user interface PCB	R1H (A2P)	* humidity sensor
A15P	* receiver PCB (wireless ON/OFF thermostat)	R1T (A1P)	inlet water thermistor
A20P	* WLAN module	R1T (A2P)	* ambient sensor ON/OFF thermostat
A30P	* bizone mixing kit PCB	R1T (A14P)	* ambient sensor user interface
B1L	flow sensor	R2T (A1P)	outlet backup heater thermistor
B1PW	water pressure sensor	R2T (A2P)	* external sensor (floor or ambient)
BSK (A3P)	solar pump station relay	R5T	* domestic hot water thermistor
CN* (A4P)	* connector	R6T	* external indoor or outdoor ambient thermistor
DS1 (A8P)	* dipswitch	S1L	flow switch
E1H	backup heater element (1 kW)	S1S	# preferential kWh rate PS contact
E2H	backup heater element (2 kW)	S2S	# electrical meter pulse input 1
E4H	* booster heater (3 kW)	S3S	# electrical meter pulse input 2
E*P (A9P)	indication LED	S4S	# smartgrid feed-in
F1B	# overcurrent fuse backup heater	S6S-S9S	* digital power limitation inputs
F2B	# overcurrent fuse backup heater	S10S-S11S	# low voltage smartgrid contact
F1T	thermal fuse backup heater	SS1 (A4P)	* selector switch
F1U, F2U (A4P)	* fuse 5 A 250 V for digital I/O PCB	SW1~2 (A11P)	turn buttons
FU1 (A1P)	fuse T 5 A 250 V for PCB	SW3~5 (A11P)	push button
K1A, K2A	* high voltage smartgrid relay	TR1	power supply transformer
K1M, K2M	contactor backup heater	X6M	# BUH power supply terminal strip
K3M	* contactor booster heater	X6M	* BSH power supply connector
K5M	safety contactor BUH	X7M, X8M	BSH power supply terminal strip
K*R (A1P-A4P)	relay on PCB	X10M	* smartgrid power supply terminal strip
M1P	main supply pump	X*, X*A, J*, X*H*, X*Y	connector
M2P	# domestic hot water pump	X*M	terminal strip
M2S	# 2 way valve for cooling mode		
M3S	* 3 way valve for space heating / domestic hot water		

* : optional
: field supply


4D133212A

8 Wiring diagrams

8 - 2 Control Circuit

8

ETBH16E6V
 ETBH16E9W
 ETBX16E6V
 ETBX16E9W





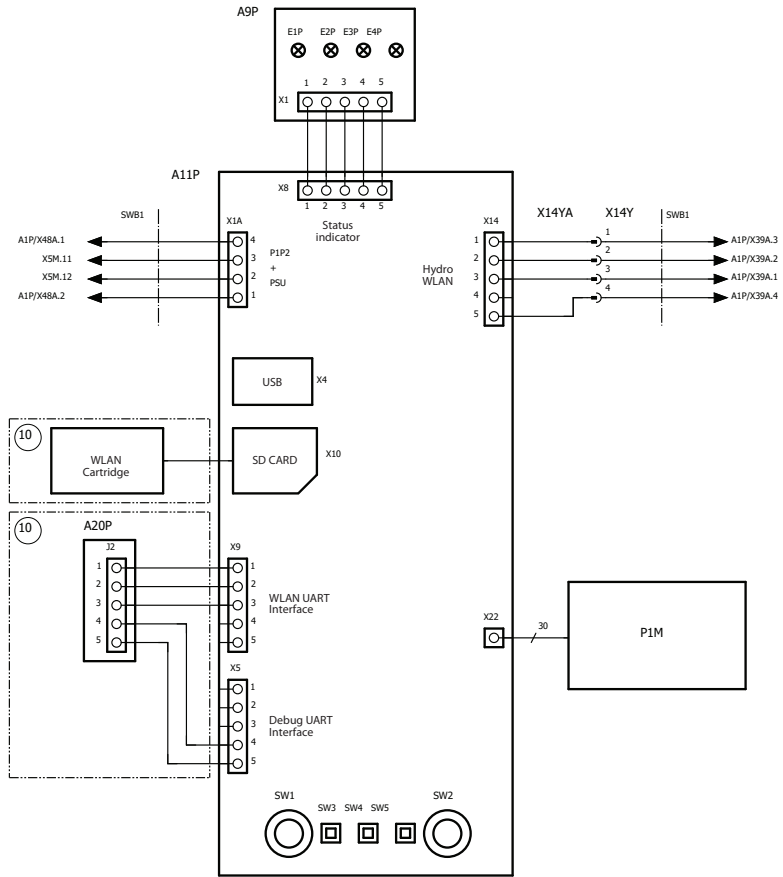


4D133212A

8 Wiring diagrams

8 - 3 Power Supply, Back-up Heater

ETBH16E6V
 ETBH16E9V
 ETBX16E6V
 ETBX16E9V

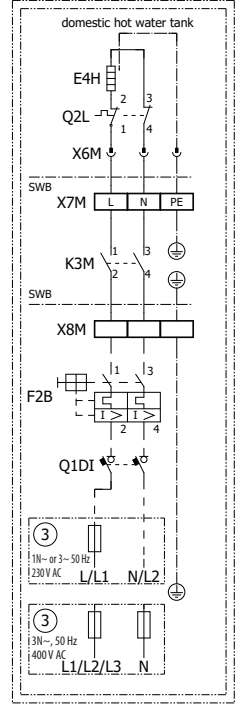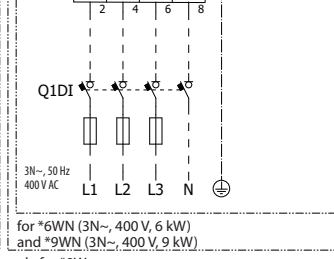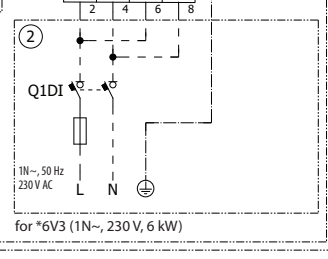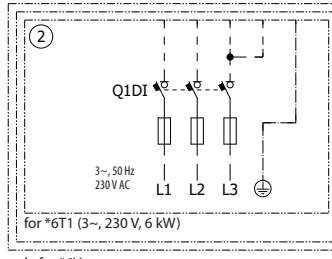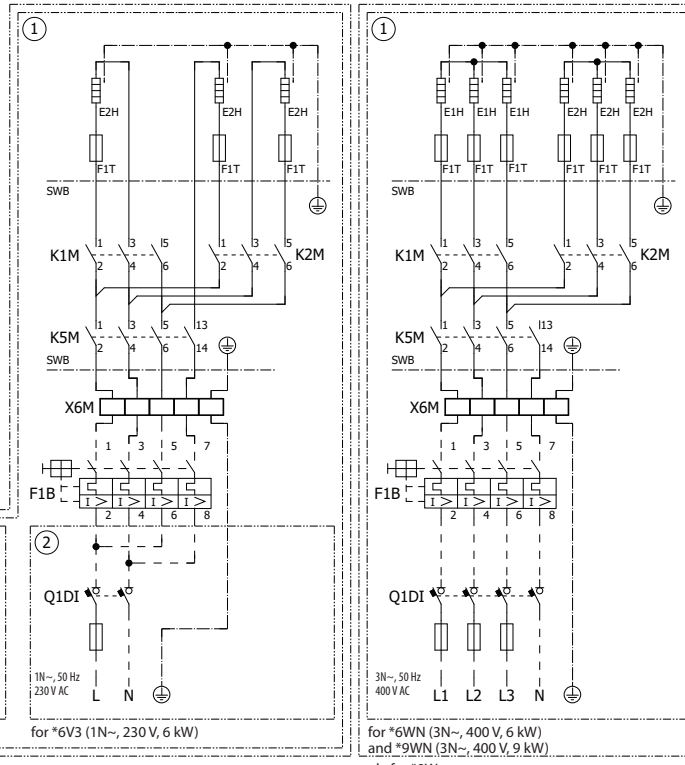


4D133212A

9 External connection diagrams

9 - 1 External Connection Diagrams

9

ETBH16E6V
ETBH16E9V
ETBX16E6V
ETBX16E9V

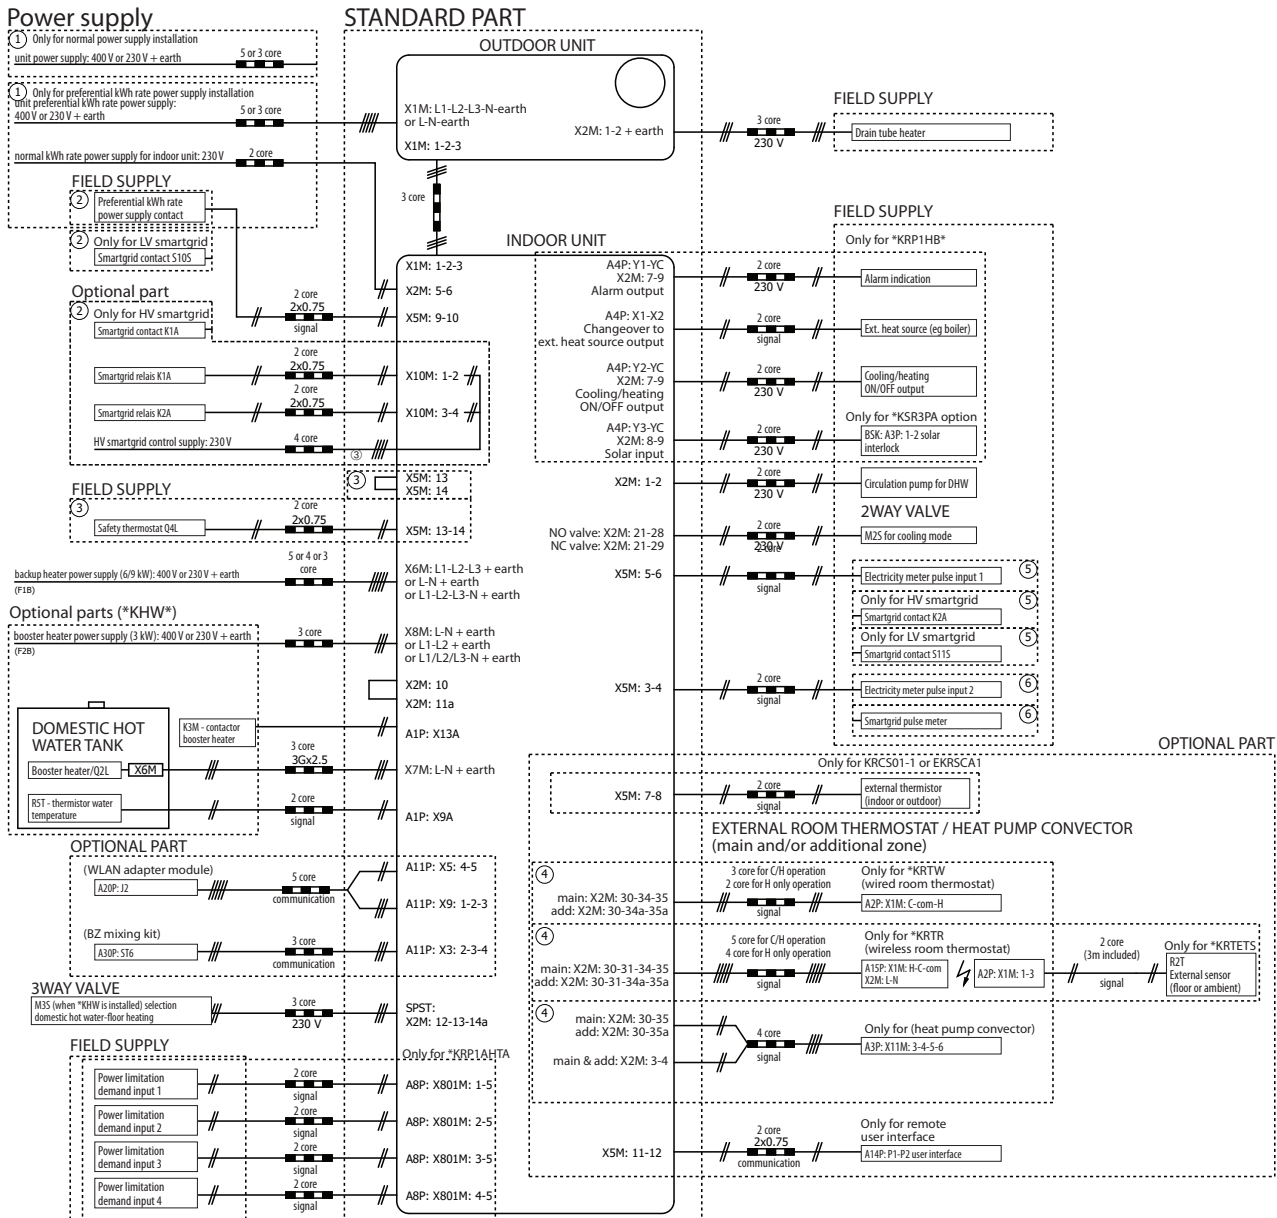

NOTE

- In case of signal cable: keep minimum distance to power cables > 5 cm
- Available heaters depending on model: see combination table


For more details please check unit wiring

4D133217A

10 Installation

10 - 1 Installation Method

ETBH12E6V
 ETBH12E9W
 ETBX12E6V
 ETBX12E9W
 ETBH16E6V
 ETBH16E9W
 ETBX16E6V
 ETBX16E9W

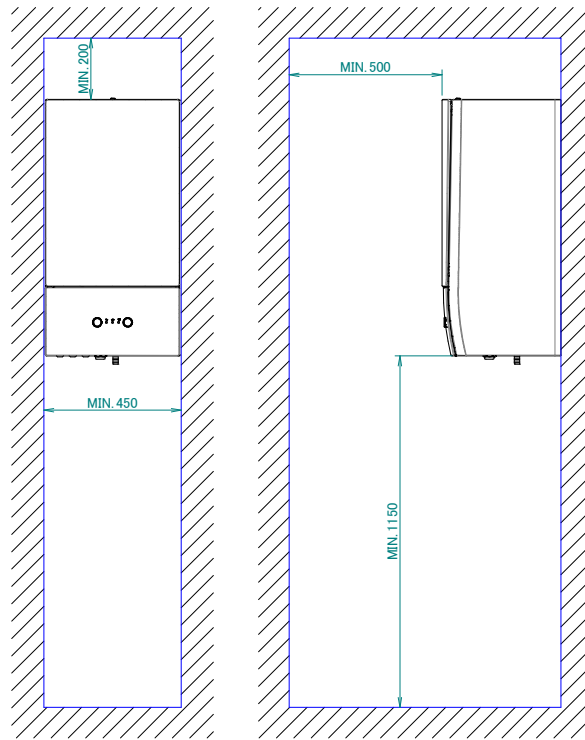





3D121023B

11 Operation range

11 - 1 Operation Range

11

ETBH16E6V
 ETBH16E9W
 ETBX16E6V
 ETBX16E9W
 ETVH16E6V
 ETVH16UE6V
 ETVH16E9W
 ETVX16E6V
 ETVX16E9W
 ETVZ16E6V
 ETVZ16E9W

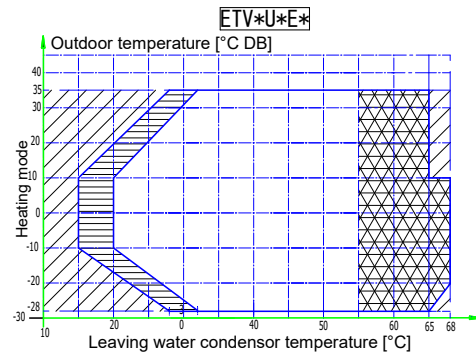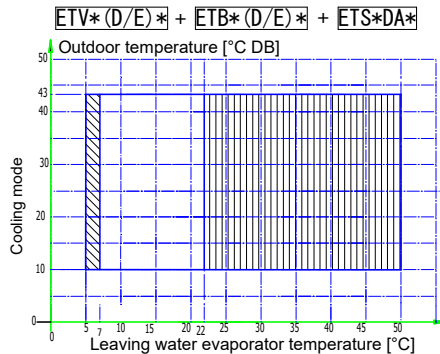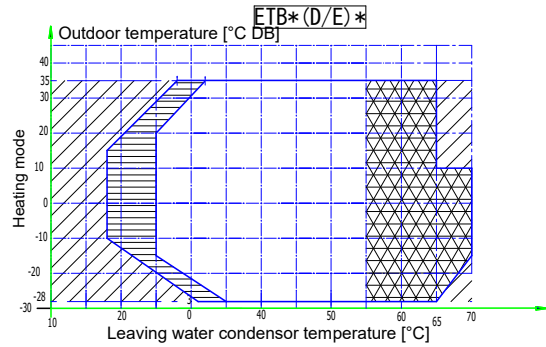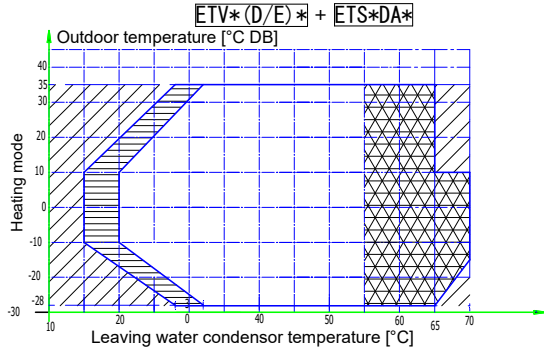

Legend

- Backup heater only operation
No outdoor unit operation
- Outdoor unit operation if setpoint $\geq -20^\circ$
- Pull-down area
- Outdoor unit operation if setpoint $> 55^\circ\text{C}$ and $\Delta T = -10^\circ\text{C}$ ($\Delta T = \text{outlet temperature} - \text{inlet temperature}$)
- In case valve kit -AFVALVE1- is part of the system, then the minimum setpoint is -7°C .

Remark


In restricted power supply mode, the outdoor unit, booster heater and backup heater can only operate separately.

3D125788B


ETBH16E6V
 ETBH16E9W
 ETBX16E6V
 ETBX16E9W
 ETVH16E6V
 ETVH16UE6V
 ETVH16E9W
 ETVX16E6V
 ETVX16E9W
 ETVZ16E6V
 ETVZ16E9W

Domestic hot water heating mode

$ETV*$

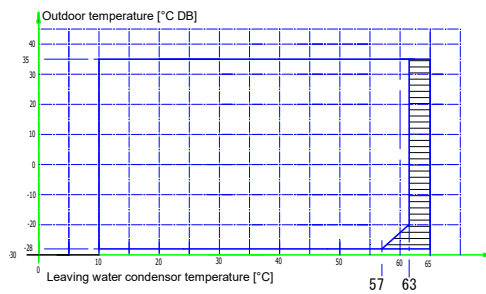

$EKHWP* + ETS* + \begin{matrix} EKHS*200* \\ EKHS*250* \\ EKHS*300* \end{matrix} + \text{Third-party with identical specifications as 'EKHS*200*'}$

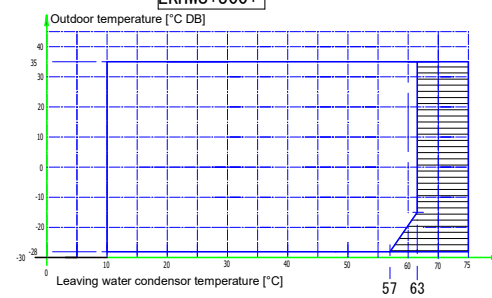

$EKHS*150*$
 $EKHS*180*$


$+ \text{Third-party with identical specifications as 'EKHS*150*'}$

Legend

- Backup heater only operation (or booster heater, if part of the system)

Remark

1. In restricted power supply mode (EKHW* only), the outdoor unit, booster heater and backup heater can only operate separately.
2. Third-party with identical specifications as 'EKHS*150*':
Coil surface $> 1.05\text{ m}^2$
Tank thermostat: top part of heat pump coil. Small overlap.
3. Third-party with identical specifications as 'EKHS*200*':
Coil surface $> 1.8\text{ m}^2$
Tank thermostat: top part of heat pump coil. Small overlap.

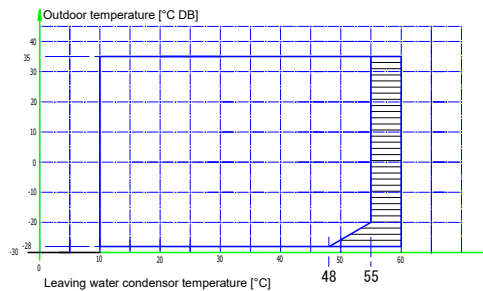


3D125789B

12 Hydraulic performance

12 - 1 Static Pressure Drop Unit

ETBH16E6V
 ETBH16E9W
 ETBX16E6V
 ETBX16E9W

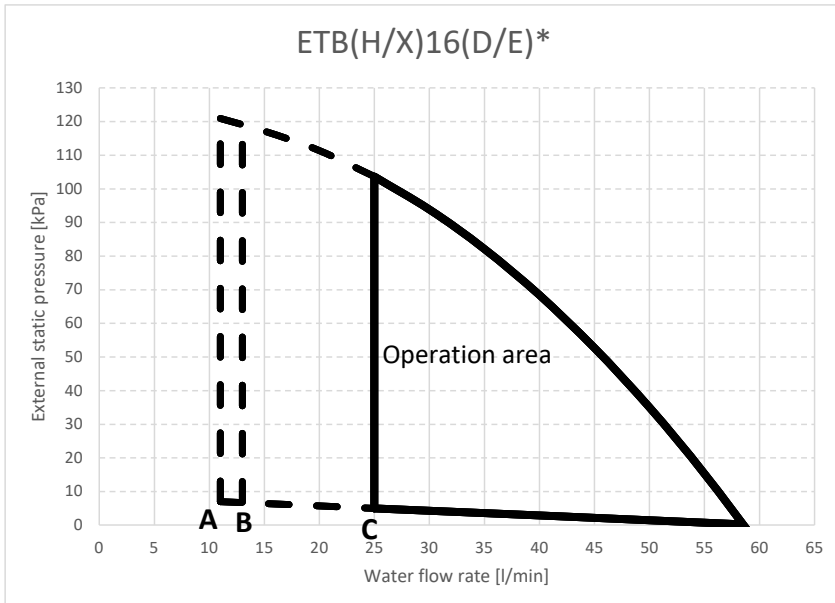


- A Minimum water flow rate during normal operation
- B Minimum water flow rate during backup heater operation
- C Minimum water flow rate during defrost operation

Operation area is extended to lower flow rates only in case the unit operates with heat pump only.
 (Not in startup, no BUH operation, no defrost operation.)
 See dashed lines

Notes

1. Selecting a flow outside the operating area can damage the unit or cause the unit to malfunction. See also the minimum and maximum allowed water flow range in the technical specifications.
2. Water quality must be according to EU directive 98/83 EC.

4D124955B



EEEDEN21

04/2021



The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin South Africa. Daikin South Africa has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin South Africa explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin South Africa.